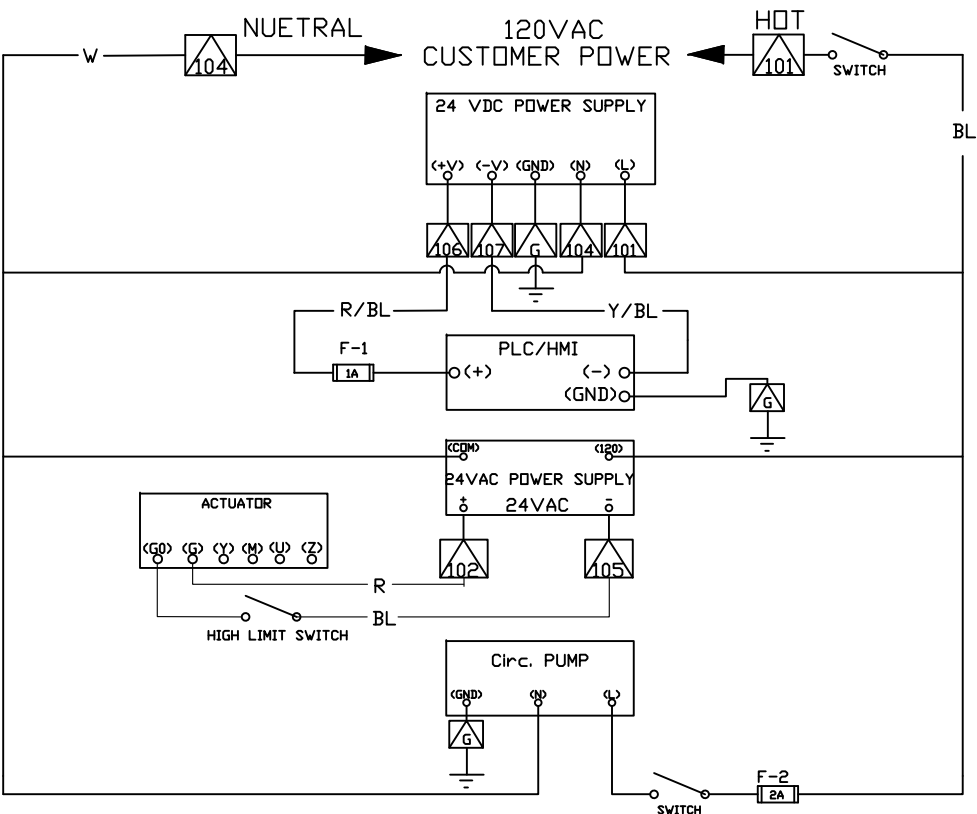





EXTERNAL CONNECTIONS		
DEVICE	TERMINALS	
MAIN POWER SUPPLY	120VAC	101,104
24VDC POWER	106,107	
24VAC POWER	102,105	
ALARM LIGHT*	114,134	
ALARM REMOTE STATUS*	115,134	
CONTROL VALVE 4-20 mA	135,136	
RTD1, DHW OUTLET TEMP.	138,139,140	
Flowmeter (IntelliFLO).	106,143	
Boiler Pump control	144	
DHW Pump control	145	

MODBUS SLAVE PORT WIRING		
	SHIP LOOSE EQUIPMENT	DENOTES EQUIPMENT MOUNTED : ■ INSIDE CONTROL PANEL ▲ ON CONTROL PANEL ● OUTSIDE CONTROL PANEL ○ CONTROL PANEL TERMINAL
	EQUIPMENT NOT SUPPLIED BY CAMUS HYDRONICS	
	MECHANICAL CONNECTIONS	
	TERMINAL DESIGNATION ON DEVICE	
		--- OPTIONAL CONNECTIONS

CONNECTION DIAGRAM

BK - BLACK BL - BLUE
BR - BROWN GY - GRAY
G - GREEN O - ORANGE
P - PURPLE R - RED
W - WHITE Y - YELLOW

Note: 1) If any of the original wire as supplied with the appliance must be replaced, it must be replaced with wiring having a temperature rating of at least 105C

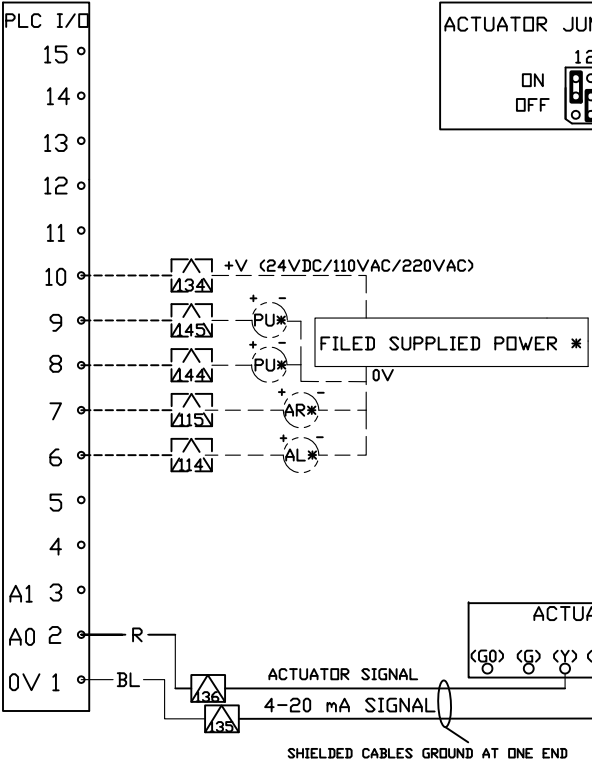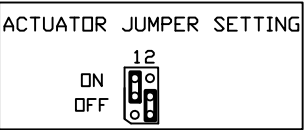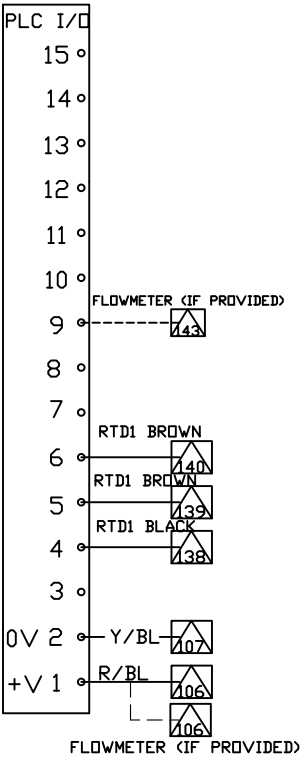

		DynaFLO			
THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF CAMUS HYDRONICS LTD. ANY REPRODUCTION IN PART OR WHOLE WITHOUT THE WRITTEN PERMISSION FROM CAMUS HYDRONICS LTD IS PROHIBITED.		120V, 60Hz Electrical Diagram			
DRAWN	PT	DATE	22-OCT-19	SIZE	C
DESIGNED	PT	DATE	22-OCT-19	DRAWING #:	99-0700
CHECKED				SCALE	N.T.S.
			SHEET	1 OF 1	REV 01