



Typical Specifications for DynaMax[®] Domestic Hot Water Boilers Models DM(N,P)W202-DM(N,P)W802

The domestic hot water (DHW) boiler shall be a CAMUS DYNAMAX HS model _____ having a modulating input rating of _____ Btu (kW) /hr. and a recovery capacity of _____ GPH (LPH) at 100°F (56°C) and shall be operated on Natural gas or L.P. Gas. The boiler shall be capable of full modulation firing down to 20% of rated input with turn down ratio of 5 to 1.

The DHW boiler shall be design certified by UL and shall meet the requirements of ANSI Z21.10.3 and CSA 4.3. The boiler shall bear the ASME "H" stamp and shall be national board listed where required.

Performance Overview:

- Boiler shall operate up to 93.0% steady state efficiency
- Heat exchanger shall be a fully condensing counter-flow water tube design with stainless steel construction and all welded design with constant allowable system return temperatures of 40F.
- Fine tuned combustion premix providing homogeneous air and gas combustion mix to a radial burner incorporating a knitted stainless steel wrap ensuring stable light off and efficient clean combustion.
- 5:1 gas input turn down ratio with sustained efficient combustion characteristics throughout entire modulating range
- Factory mounted integral pump, with pre and post purge timing
- Cascade capable integrated control system allowing up to 8 units in lead-lag configuration
- Oxides of Nitrogen (NOx) of 9 ppm corrected to 3% oxygen.
- Category IV venting models: 0202 to 0252
- Category II venting models: 0212 to 0802
- The boiler is fully factory fire tested to obtain optimum combustion characteristics and to establish certified gas input rates.
- System safety and operating devices and controls are fully configured, calibrated and factory tested.
- The boiler shall comply with the energy efficiency requirements of the latest edition of the ASHRAE 90.1 Standard.
- Stainless steel outer jacket construction with easily removed outer panels for ease of service

Heat Exchanger: The heat exchanger shall be inspected and tested to A.S.M.E. Section IV requirements. The A.S.M.E. Section IV seal of approval will not be provided as standard for jurisdictions not requiring the A.S.M.E. Section IV seal of approval. The heat exchanger shall be a counter-flow water tube design with multi-pass stainless steel all welded construction heat exchanger with maximum working pressure of 160 PSI (1100 kPa). The heat exchanger design shall be capable of 40°F constant system return temperatures to enable fully condensing operation. A pressure relief valve of _____ lb/hr shall be furnished with the heater.

Combustion Chamber: The combustion chamber shall be an all welded stainless steel construction which shall be sealed and completely enclosed, independent of the outer jacket assembly. The Stainless Steel combustion chamber shall be designed to drain condensation to the bottom of the heat exchanger assembly. A condensate collection box shall be employed to trap and neutralize flue product condensate. A window view port shall be provided for visual inspection of the boiler combustion during firing.

Gas Train: The gas train shall consist of a pressure regulating electro-hydraulic proportional air/gas main gas actuator providing a slow opening, fast closing automatic gas valve safety shutoff and gas pressure regulator. Optional high and/or low gas pressure switch is available. Models DM 200 – DM 800 operate with a 5:1 turndown ratio.

Burner: The burner shall be a premix design and constructed of high temperature Stainless Steel with metal fiber outer covering to provide modulating firing rates. The burner shall provide equal distribution of heat through the entire heat exchanger. A window view port shall be provided for visual inspection of the boiler during firing.

Controls: Standard controls include a SOLA electronic proportional integrated combination ignition limit/operator control accurate to 10F (0.50C) having a pulse width modulation signal output for modulating fan speeds. Controls are lead lag "Cascade" ready for control of up to eight boilers c/w Indoor outdoor reset and lead lag control. Control shall be equipped and ready with 4-20 mA remote set point or modulating control, capable with 0-10 VDC remote set point or modulating control. Control is BMS Modbus RTU protocol ready and capable of other alternate protocol conversions with additional optional gateway protocol converter. Control shall be supplied with a mounted multi-line user configurable display which shall also provide for control system



Typical Specifications for DynaMax[®] Domestic Hot Water Boilers Models DM(N,P)W202-DM(N,P)W802

configuration and set up, readouts of boiler target, differential and inlet/outlet temperatures as well as accumulated runtime, enunciator diagnostics, and firing rates. The display shall be accessed through a 5-way touchpad high resolution LCD control with shortcut key access with user and installer protected parameters. The boiler safety control string shall be furnished with controls for optional low gas pressure, optional high gas pressure, blocked flue, high limit, stack limit and flow switch. A current transformer is supplied with all wall hung models to perform flow switch functionality. A paddle style flow switch shall be provided loose on floor mount models. Additional control safeties shall include flame rectification, fan speed, and high limit.

Venting Options:

The following venting options shall be utilized:

- Category II Venting – combined vent*
- Category IV Outside Air (Horizontal & Vertical)
- Category IV Through-wall Venting (Horizontal & Vertical)
- Outdoor Venting
- Category IV Direct Venting

*Category II combined vent shall only employ an engineered vent system prepared by a certified vent manufacturer, this can only be used with DynaMax HS floor mount models DM212-802.

The following category II and IV vent materials shall be utilized

- Stainless or AL29-4C for all system applications
- Polypropylene (PPE) for all system applications
- CPVC for hydronic heating systems
- PVC for select low temperature systems only – consult factory

The boiler shall be vented as a through-wall (vertical or horizontal) Category IV condensing appliance for up to 100 equivalent ft using material approved for use on condensing application under standard ULC S636 or equivalent, or as permitted by the local jurisdiction. The following air intake options shall be utilized:

- Outside air sealed direct (vertical or horizontal);
- Outside air ducted to jacket flange;
- Indoor air.

External Jacket and Fasteners: The external jacket shall be of 430 stainless steel mirror finish panels and powder coated steel assembled utilizing interference fit locks and minimal non-strip self tap screws for ease of removal and access to the heat exchanger and combustion air / gas control.



Typical Specifications for DynaMax[®] Domestic Hot Water Boilers Models DM(N,P)W202-DM(N,P)W802

Primary Heat Exchanger Head Loss and Flow

Model	Temperature Rise Across Heat Exchanger	
	20°F	
	USGPM	ΔP-Ft.
0202	19.2	25.9
0212	19.2	25.9
0252	23.5	28.3
0262	23.5	28.3
0292	28.8	25.8
0392	38.4	23.9
0502	48.6	29.4
0602	57.6	34.2
0702	70.4	40.0
0802	77.6	43.2

Heat Exchanger Water Content

Model	Water Content (Gal)	Wetted Heating Surface (Sq.Ft.)
0202/0212	1.69	21.8
0252/0262	1.69	21.8
0292	2.26	29.1
0392	3.28	41.8
0502	3.97	50.8
0602	4.49	58.1
0702	4.49	58.1
0802	5.07	65.3

Recovery Capacity

Model	100°F Rise GPH	56°C Rise LPH	80°F Rise GPH	44°C Rise LPH	60°F Rise GPH	33°C Rise LPH
0202	223	844	279	1056	371	1404
0212	223	844	279	1056	371	1404
0252	279	1056	348	1317	464	1756
0262	279	1056	348	1317	464	1756
0292	333	1260	417	1578	555	2101
0392	445	1684	556	2105	741	2805
0502	557	2108	697	2638	929	3517
0602	669	2532	836	3165	1115	4221
0702	780	2952	975	3691	1301	4925
0802	892	3376	1115	4221	1487	5629

Voltage Requirement

Model	Voltage Requirement
0202-0502	120VAC, 60Hz, 1 Phase
0602-0802	230VAC, 60Hz, 1 Phase

Input/Output

Model	Input Btuh Range	Max Output Btuh
0202	40-200	186
0212	40-199	186
0252	50-250	232.5
0262	50-250	232.5
0292	60-299	278
0392	80-399	371
0502	100-500	465
0602	120-600	558
0702	140-700	651
0802	160-800	744

Approx. Shipping Weight

Model	Weight (lbs)
0202	210
0252	220
0212	315
0262	320
0292	376
0392	405
0502	470
0602	610
0702	615
0802	630



Typical Specifications for DynaMax® Domestic Hot Water Boilers

Models DM(N,P)W202-DM(N,P)W802

Submittal Data Sheet

DynaFlame® Hydronic Heating, Non-Condensing

Date: _____

Quote No.: _____

Engineer: _____





Prepared by: _____

Job Name: _____

Job Location: _____

Buyers Name: _____

Buyers Address: _____

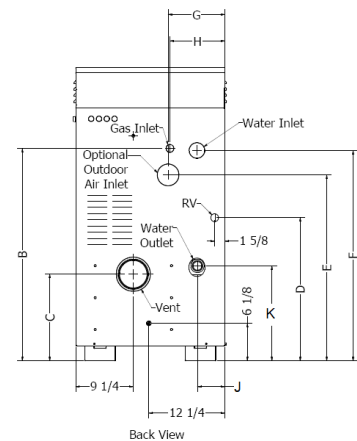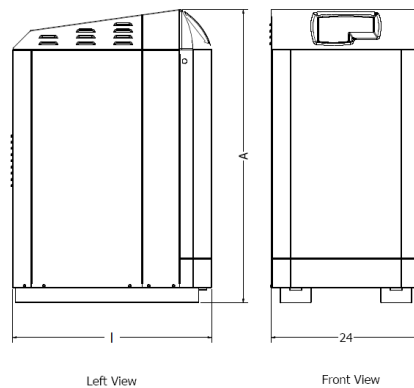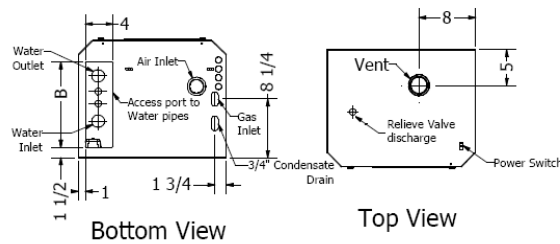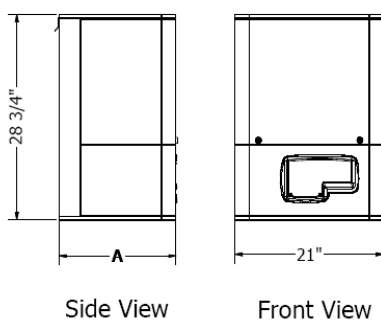

Model	Dim "A" [in.]	Dim "B" [in.]	Dim "C" [in.]	Dim "D" [in.]	Dim "E" [in.]	Dim "F" [in.]	Dim "G" [in.]	Dim "H" [in.]	Dim "I" [in.]	Dim "J" [in.]	Dim "K" [in.]	Length of Vent and Air Intake Pipes at Recommended Dia. [in.]			Cat. II Vent	Water Conn. [in.] NPT	Gas Conn. At Boiler [in.] NPT
												over 25' and up to 100'	over 15' and up to 25'	up to 15'			
0202	23 1/2	19	-	-	-	-	-	-	-	-	-	3	3	2	-	1	1/2
0212	42 1/2	25 3/4	14 1/4	23	24 1/4	34 1/4	14 3/4	14 1/4	32	4 3/8	15 1/4	3	3	2	4	1	1/2
0252	23 1/2	19	-	-	-	-	-	-	-	-	-	3	3	2	-	1 1/4	1/2
0262	42 1/2	25 3/4	14 1/4	23	24 1/4	34 1/4	14 3/4	14 1/4	32	4 3/8	15 1/4	3	3	3	4	1 1/4	1/2
0292	47 1/8	34 1/8	14 1/4	23	29 7/8	33 7/8	9 1/8	8 7/8	32	4 3/8	15 1/4	4	3	3	5	1 1/4	3/4
0392	47 1/8	34 1/8	14	23	29 7/8	33 7/8	9 1/8	8 7/8	32	4 3/8	15 1/4	4	3	3	5	1 1/2	1
0502	47 1/8	34 1/8	14	23	29 7/8	33 7/8	9 1/8	8 7/8	32	4 3/8	15 1/4	4	3	3	6	1 1/2	1
0602	47 1/8	36 1/4	14	23	30 3/4	38	9 1/8	10 1/8	40 1/2*	3 5/8	14 3/8	4	3	3	6	2	1
0702	47 1/8	36 1/4	14	23	30 3/4	38	9 1/8	10 1/8	40 1/2*	3 5/8	14 3/8	4 (Air), 6 (Vent)	4	4	7	2	1
0802	47 1/8	36 1/4	14	23	30 3/4	38	9 1/8	10 1/8	40 1/2*	3 5/8	14 3/8	5 (Air), 6 (Vent)	5	5	7	2	1

Model No.: _____ No. of Units: _____ Type of Gas: _____

Total Input: _____ BTU/hr Total Output: _____ BTU/hr

Flow: _____ USGPM @ Allowable Pressure Drop _____ ft.

Optional Accessories: _____