

CASING

Steel casing is covered with high quality multilayer aluminium and zinc alloy to prevent corrosion. The casing is equipped with a switch to turn the ventilator off when the service panel is opened. Service access from both left and right side. For outdoor installation the roof is necessary (optional).

ENERGY RECOVERY CORE

Unique enthalpy heat exchanger provides high-efficient heat & humidity recovery. No drain pan required.

FANS

The unit is equipped with supply and exhaust centrifugal fans featuring backward-curved blades and advanced EC (Electronically Commutated) motor technology. These fans deliver superior energy efficiency and precise speed control. They come with built-in thermal overheating protection and an automatic restart function, ensuring consistent and reliable performance. Additionally, both the electric motors and impellers are dynamically balanced to minimise noise and vibration, providing smooth and efficient.

DEFROST SYSTEM

Fan stop defrost system is activated when the outdoor temperature falls below 23° F (-5° C).

FILTER

Washable MERV 6 air filters in exhaust and supply air streams. Filters MERV 8, MERV 13 optional.

ERV 5 EC

Additional Air Pressure Drop with optional filters			
Filter type	Airflow CFM		
	100	200	300
MERV 8	0,03	0,06	0,08
MERV 13	0,2	0,4	0,53

ERV 8 EC

Additional Air Pressure Drop with optional filters			
Filter type	Airflow CFM		
	150	300	450
MERV 8	0,04	0,08	0,11
MERV 13	0,25	0,5	0,67

CONTROL


The unit incorporates an integrated automation and control system with following functions:

- Operation mode switch.
- Airflow balancing by supply and exhaust fan independent speed adjustment.
- Automatic recovery core frost protection.
- External control device connection.





DIMENSIONS

Measurements [in]					
A	A2	H	H2	H3	L
25 1/2"	14"	26"	8"	4"	36 1/2"

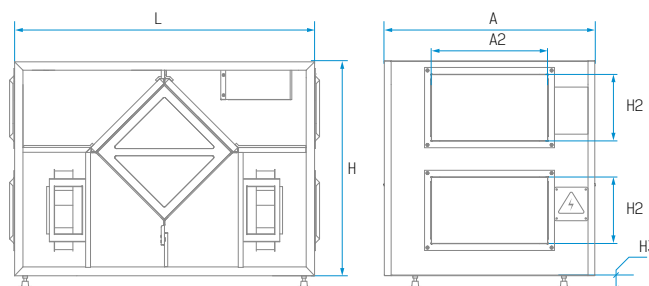

TECHNICAL DATA

Parameters	AIRLITE ERV 5 EC
Voltage [V / 60 Hz]	1 ~ 208
Unit power [W]	330
Unit current [A]	2.4
Minimum circuit Amps [MCA]	3.0
Maximum over current protection [MOP]	3.9
Sensible effectiveness @ max airflow [%]	63
Air flow @ ESP 0.4" WG [cfm]	400
Air flow max [cfm]	490
Transported air temperature [F]	-35 up to +140
Outer skin casing material	21 gauge galvanized steel
Insulation	1" mineral wool
Connected air duct size [in]	8x14
Weight net [lb]	110
Weight gross [lb]	225

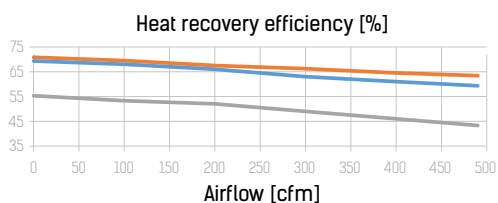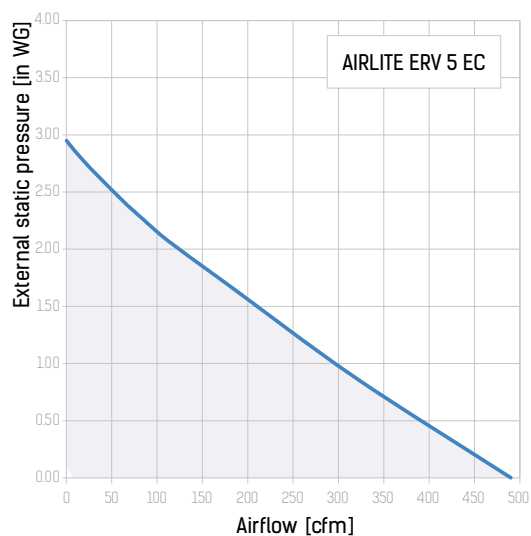

— Sensible winter & summer
— Winter total
— Summer total

Acoustic Noise Power Chart (dBA) at unit ports



Airflow	Fresh air to building port	Exhaust air from building port
400 CFM at 0.4 in. w.g.	70 dBA	70 dBA
160 CFM at 0.2 in. w.g.	53 dBA	53 dBA

Note: Efficiencies are based on AHRI standard conditions

	Summer mode			Winter mode		
	Outdoor Air	Return Air	Supply Air	Outdoor Air	Return Air	Supply Air
Standard Flow Rate CFM	400	400	400	400	400	400
Dry Bulb °F	95	75	83	35	70	59.2
Wet Bulb °F	78	63	71.7	33	58	50.3
Enthalpy (H) BTU/lb	41.5	28.6	35.6	12.2	25.1	20
Moisture Ratio (MR) gr/lb	117.3	66.7	98.5	24.4	52.6	39.8

TECHNICAL DATA

Parameters	AIRLITE ERV 8 EC
Voltage [V / 60 Hz]	1 ~ 208
Unit power [W]	480
Unit current [A]	3.4
Minimum circuit Amps [MCA]	4.3
Maximum over current protection [MOP]	5.6
Sensible effectiveness @ max airflow [%]	65
Air flow @ ESP 0.4" WG [cfm]	580
Air flow max [cfm]	650
Transported air temperature [F]	-35 up to +140
Outer skin casing material	21 gauge galvanized steel
Insulation	1" mineral wool
Connected air duct size [in]	8x14
Weight net [lb]	148
Weight gross [lb]	258

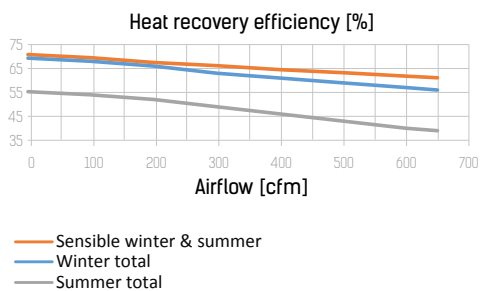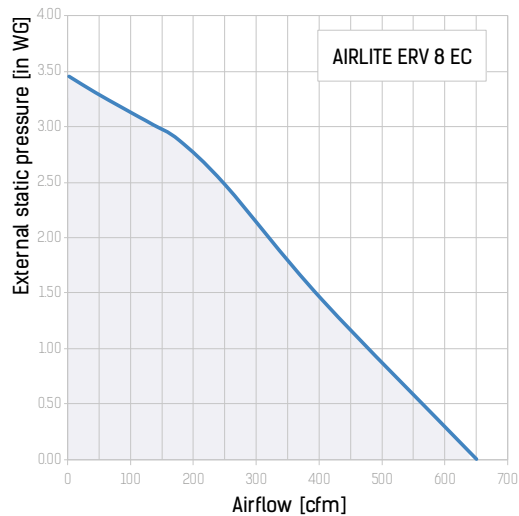

Acoustic Noise Power Chart (dBA) at unit ports

Airflow	Fresh air to building port	Exhaust air from building port
580 CFM at 0.4 in. w.g.	72 dBA	72 dBA
230 CFM at 0.2 in. w.g.	54 dBA	54 dBA

Note: Efficiencies are based on AHRI standard conditions

	Summer mode			Winter mode		
	Outdoor Air	Return Air	Supply Air	Outdoor Air	Return Air	Supply Air
Standard Flow Rate CFM	580	580	580	580	580	580
Dry Bulb °F	95	75	83.4	35	70	58.5
Wet Bulb °F	78	63	72.3	33	58	49
Enthalpy (H) BTU/lb	41.5	28.6	36.1	12.2	25.1	19.7
Moisture Ratio (MR) gr/lb	117.3	66.7	101.3	24.4	52.6	36.3

MODEL	QUANTITY	COMMENTS	PROJECT
			location:
			architect:
			engineer:
			contractor:
			submitted by: